

Government of Andhra Pradesh
A.P. State Disaster Response and Fire Services Department
Provisional Fire No Objection Certificate

File No: 25553/TPT/MSB/2025

Date: 03/04/2025

Sir/Madam,

Sub: Andhra Pradesh State Disaster Response and Fire Services Department - Issue of Provisional No Objection Certificate to the Proposed Construction of Educational Building of **(CHAMPION VIDYALAYA) NALLAREDDY HITESHREDDY, NEAR TOWER, KADALURU, TADA MANDAL, TIRUPATI-524121** - Regarding.

Ref: 1. Online Application Dt. 19-03-2025

You are hereby issued Provisional NOC for School/College building subject to the following reasonable fire prevention and safety methods.

1.Ensure two exits for every building from the following:

- a. One Staircase and a ramp widely separated from each other.
- b. Two Staircases widely separated from each other.
- c. One Staircase and fenced pathway to adjacent buildings on all floors suitable for Evacuation of students.
- d. One Staircase and a tube lift (transparent fireproof lift fitted outside the building) with an exhaust fan on top (to remove smoke from the lift if any) powered by the main generator.
- e. If the second staircase is not possible, provide a slider or tube lift with exhaust fan (connected outside to building), or a German chute, or horizontal connection between the neighborhood buildings.

This is to ensure more than one exit pathway teachers, students and staff to evacuate in case of any fire incident towards safe place. We have lost many lives in accidents due to lack of alternative exit the only exit was engulfed in smoke and fire.

2.Electrical Safety:

- a. Installation of Miniature Circuit Breakers (MCBs) on all floors.
- b. No overloading of power sockets in any Educational Building.
- c. 10 years old wiring to be changed, especially where high power consuming appliances such as Air conditioners, Electrical/Mechanical/Computer labs, Data Centers, High tech labs, etc.,
- d. Grounding/Earthing shall be done.
- e. Lightning conductors may be provided for high rise buildings exceeding 5 floors.
- f. No High Tension Lines should run inside or in close proximity (<6 meters) to any Educational institution buildings.

The above is to prevent the electrical short circuits which are the root-cause in 90% of the School fire accidents across the country.

Kitchen Safety:

- a. Kitchen should be away from class rooms , dormitories and labs. Preferably in separate building.
- b. Kitchen shall be separated from other parts of the same building by 60 min fire rated wall and fire resistance doors.

- c. However, no kitchen shall be allowed in the same multi-storey building having classrooms or dormitories in upper floors.
- d. Two 4.5 kg Co₂ Fire Extinguishers, Gas Detection and Alarm System shall be installed, they shall be kept in good working condition.
- e. LPG Cylinders shall be located outside the kitchen with proper ventilation and protection from Rain and Sunlight.
- f. Five Ways of putting up LPG Cylinder Fires (Pictorial /Cartoon) shall be displayed in the kitchen.

4. Water availability @ all floors:

- a. Minimum pressure of water to put out the fires to be 3.5 Kg/cm². The more the better. For each floor 5HP (Pump + electrical motors connected to main generator or fuel motor) to be connected to normal plumbing system.
- b. This is to put out initial fires till the fire engine arrives.
- c. The pressure of water can be obtained through any ISI marked pumps which are reliable, easy to maintain and affordable.
- d. These pumps should be easily handled by women teachers, students and staff without any special training.
- e. These pumps should be flexible to draw water from normal taps or sump or drain or any water source available in the building.
- f. Water in sump or overhead tank that can be used for initial firefighting purpose should be reasonable to last for half an hour.
- g. You are not obligated to buy from any particular vendor or hire any particular contractor or be guided by any liaison officer or middleman to install fire safety equipment.
- h. Please don't use water sprinklers in any computers, electrical or chemistry labs as they will compound the problem.
- i. Use Co₂ Cylinders or Dry Chemical powder fire extinguishers @ every floor with one per 100 Sq.Meters.

Usually the Response time of fire engine arrival is about 20 minutes. The above arrangements give tools to put out the initial fires to the people (teachers, students and staff) who happen to be present in school at the time of any fire incident before the fire engine arrives. So, any equipment installed should be easy to use by everyone. If the teachers, students and staff can't handle, don't install any equipment.

5. Smoke Test:

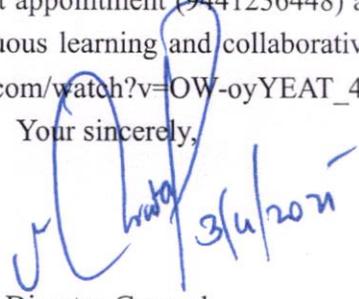
In case of fully Air conditioned buildings, in most fire accidents, it is smoke that suffocate and kills. Fully air conditioned buildings are generally sealed and there is no vent for smoke to escape. Therefore, we are mandating smoke management which is ensured through "Smoke Test". (This is not applicable in case of partial air conditional buildings where smoke can easily disperse into air unlike in fully covered buildings).

- a. "Smoke Test" tests to ensure the staircases free from smoke for about 2 hours to enable all students, teachers and staff to evacuate from the building in case of any fire accident.
- b. Make sure air conditioner ducts don't compound the problem by carrying smoke to all parts of the building.
- c. Fire proof materials such as iron doors, iron shutters, thick glass, curtains that can shield smoke can be used.
- d. Also exhaust fans that are connected to standby power source can be installed to evacuate smoke from staircases or exit paths.

6. Where schools are not permitted:

- a. In thatched roof or any inflammable material roof (Plastic sheets etc.,) buildings.
 - b. In cellar or basement of buildings.
 - c. In mixed occupancies where the ground floor is occupied with any shops particularly cloth, chemicals or any toxic inflammable materials.
7. Therefore, this building meets the “**reasonable fire safety criteria**” as envisaged in NBC and hence the Provisional Fire No Objection Certificate is issued.
8. As a Policy, no retrospective application of rules shall be made for building as long as they comply with that NOC requirements till the life of the building.
9. If you experience any undue hardship or practical difficulty in implementing any of the above suggested requirements, please don't hesitate to meet in person without appointment (9441236448) as ensuring fire safety with better and affordable technology is a continuous learning and collaborative endeavour.(for school fire safety mock drill, visit https://www.youtube.com/watch?v=OW-oyYEAT_4)

Your sincerely,


Director General

State Disaster Response & Fire Services
Andhra Pradesh, Vijayawada

To

The Management of CHAMPION VIDYALAYA, NALLAREDDY HITESHREDDY, NEAR TOWER,
KADALURU, TADA MANDAL, TIRUPATI-524121

Copy to the District Educational Officer, Concerned.

Pratap Madireddy, IPS
Director General
Disaster Response and Fire Services Department
Andhra Pradesh



pratapspt@gmail.com
+ 91- 866 -2570101

Dear Applicant

Namaste. Please note that We are here to help you to ensure reasonable fire safety. If you face any difficulty, please don't hesitate to come and meet me in person at my office. You don't require any appointment. Be my guest.

Also, don't believe any mediators, liaison persons. We have no such mediators or liaison persons. Don't give any money to any of such people.

You are not required to appoint any particular Vendor. We have "no" preferred Vendors. you are at liberty to appoint or get work done by any contractor you prefer and trust. I have instructed fire department officials not to recommend any Vendors, Contactors. Please don't take any Such recommendations.

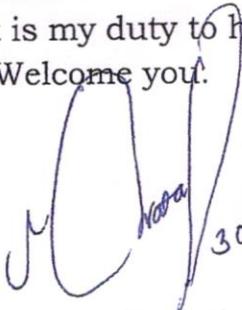
I have learnt that some contractors are offering to fix Safety equipment for the purpose of "fire safety" inspection and then removing after the inspection is Over. Please don't fall prey to such unscrupulous people as you will be paying the price of unsafe premises and any "NOC" issued will be cancelled for the building.

We send for inspection officers from outside the jurisdiction after selecting them based on their integrity and competence. Don't give them any money. If anyone demands any favour, please inform me on my personal phone number **9441236448**. I promise to do justice. You will not be penalised.

Help me to help you to see that entire "NOC" issuing process is carried out in most transparent manner, without any corruption, without any harassment, with genuine desire to help you to solve your genuine difficulties, undue hardship in putting up Some requirements as advised by NBC guidelines which has no statutory backing. It is from your hardships in implementation that we learn and modify requirements based on scientific evidence or experiments for the future buildings as "fire safety" improvement is a continuous process as better technologies come to our aid.

Don't be mislead by any middleman, we have "none". Come and meet me Don't part with Single rupee of your Valuable money. It is my duty to help you get clearances and Certificates from fire department and I Welcome you.

With regards


30/7/2024

Director General
State Disaster Response and Fire Services,
Andhra Pradesh, Vijavawada.